


COUNTERPOISE

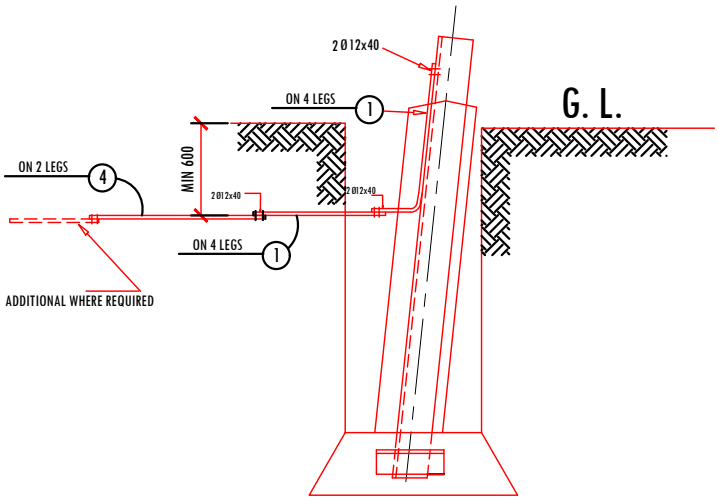


3RD SOLUTION- REQUIRED LIST FOR ONE COMPLETE TOWER		
QTY	MARK	DESCRIPTION
8	1	PL 40 X4-Lg. 1500
2	4	PL 40 X4-Lg. 6000
20	-	BOLTS Ø 12X40
-	-	PL 40 X4-Lg. 10000
-	-	BOLTS Ø 12X40

ADDITIONAL (WHERE REQUIRED)





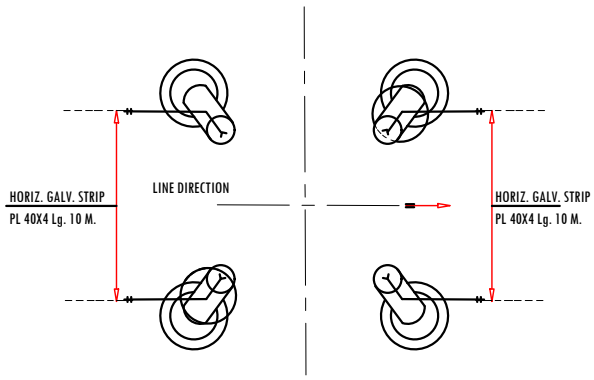

PLAN

ADDITIONAL GROUNDING
(WHERE REQUIRED)

FOR TENDERING ONLY

DATE	REFERENCE DRAWING	NUMBER

REVISION			
NO	BY	DATE	DESCRIPTION

APPROVED BY
DIRECTOR OF ENGINEERING PLANNING & DESIGN

THIS DRAWING IS THE PROPERTY OF GHANA GRID COMPANY LTD. AND IS NOT TO BE COPIED OR USED WITHOUT ITS WRITTEN PERMISSION

DATE	OCTOBER, 2020
SCALE	NONE
DRAWN BY	
DESIGNED BY	
CHECKED BY	

PROJECT: 330kV TRANSMISSION LINE PROJECT

TITLE: TOWER EARTHING SYSTEMS (TYPICAL DETAILS - COUNTERPOISE)

FOR APPROVAL ☐
FOR CONSTRUCTION ☐
FOR INFORMATION ☐

Ghana Grid Company Ltd
P.O Box CS 7979, Tema,Ghana
Tel:0303 304818 /0303 310310
Fax :0303 676180 /0303 303327
Email: gridco@gridcogh.com,web:www.gridco.com

GRIDCo
Backbone to Power Delivery

sheet size: A3 | Drawing no.: xxxx | sheet: 3 | of: 3 | rev: xx

DWG. NO.
ENG/ABV/TE/03